

Human Lung Total RNA

| | | |
|------------------------------|------------------------|-------------------------------|
| Catalog No. 636524 | Amount 50 µg | Lot Number 1610009A |
|------------------------------|------------------------|-------------------------------|

Description

Total RNA isolated by a modified guanidinium thiocyanate method (Chomczynski and Sacchi 1987).

Package Contents

- 50 µg Total RNA from the tissues/cells specified below

Storage Conditions

- Store at -70°C .

Form

- Total RNA provided in RNase-free water.

Concentration

- 1 µg/µl

Total RNA Source

- Normal human lung pooled from 3 male/female Caucasians, ages: 32-61; cause of death: sudden death
- No further RNA source information is available.

Shelf Life

- 1 year from date of receipt under proper storage conditions.

Shipping Conditions

- Dry ice (-70°C)

Important Note

- To prevent contamination by RNases, always wear gloves when handling RNA. Avoid multiple freeze/thaw cycles.

References

Chomczynski, P. & Sacchi, N. Single-step method of RNA isolation by acid guanidinium thiocyanate-phenol-chloroform extraction. *Anal. Biochem.* **162**, 156–9 (1987).

Takara Bio USA, Inc.

1290 Terra Bella Avenue, Mountain View, CA 94043, USA
U.S. Technical Support: techUS@takarabio.com

| | | | |
|--|---------------------------------|------------------------------|-----------------------------|
| United States/Canada 800.662.2566 (112916) | Asia Pacific +1.650.919.7300 | Europe +33.(0)1.3904.6880 | Japan +81.(0)77.565.6999 |
|--|---------------------------------|------------------------------|-----------------------------|

Certificate of Analysis

Cat. No. 636524


Human Lung Total RNA

Quality Control Data

This lot of total RNA was analyzed by capillary electrophoresis (CE) using an Agilent 2100 Bioanalyzer. The actual electropherogram trace for this RNA is provided below. RNA concentration and purity were evaluated by UV spectrophotometry.

Both the area ratio of the 28S/18S rRNA peaks, and the proportion (relative percentage) of these two peak areas to the total area under the electropherogram provide reliable quantitative estimates of RNA integrity. For both of these criteria, this sample meets or exceeds our standards for high-quality total RNA.

Peak Areas: 28S: 17.3% 18S: 13.4% Ratio 28S/18S: 1.3 Ratio A_{260}/A_{280} : 2.2

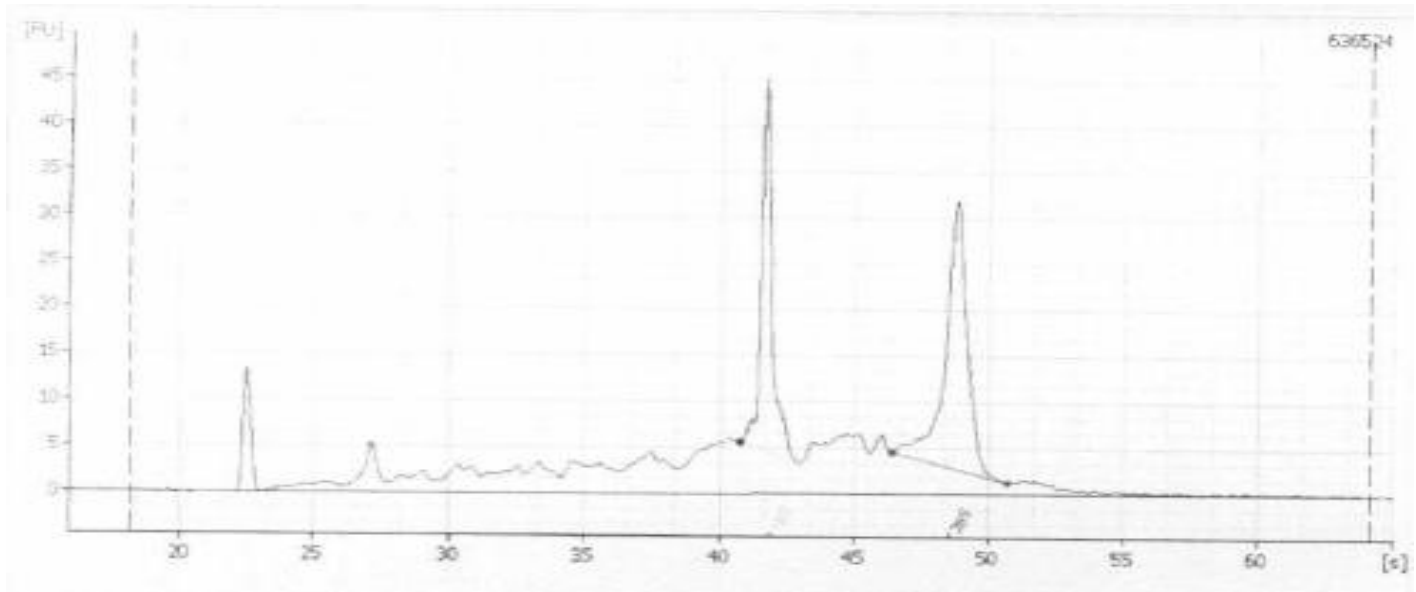

It is certified that this product meets the above specifications, as reviewed and approved by the Quality Department.

Human Lung Total RNA

CATALOG NO.

636524

NOTICE TO PURCHASER:

Our products are to be used for research purposes only. They may not be used for any other purpose, including, but not limited to, use in drugs, in vitro diagnostic purposes, therapeutics, or in humans. Our products may not be transferred to third parties, resold, modified for resale, or used to manufacture commercial products or to provide a service to third parties without prior written approval of Takara Bio USA, Inc.

Your use of this product is also subject to compliance with the licensing requirements listed below and described on the product's web page at <http://www.takarabio.com>. It is your responsibility to review, understand and adhere to any restrictions imposed by these statements.

TRADEMARKS:

©2016 Takara Bio Inc. All Rights Reserved.

All trademarks are the property of Takara Bio Inc. or its affiliate(s) in the U.S. and/or other countries or their respective owners. Certain trademarks may not be registered in all jurisdictions.

Takara Bio USA, Inc.

1290 Terra Bella Avenue, Mountain View, CA 94043, USA

U.S. Technical Support: techUS@takarabio.com

United States/Canada

800.662.2566

Asia Pacific

+1.650.919.7300

Europe

+33.(0)1.3904.6880

Japan

+81.(0)77.565.6999

12/1/2016